

Example 2 – hand calculations – solid fencing for wind loading – no ice loading

6' mostly solid wooden fence no gap at the bottom 96' long 8' post spacing Elevation - 1,086 ft

5-1/4" wooden pickets w/ 1/4" gaps 5-1/2" picket spacing Solidity Ratio,  $\epsilon = 5.25 / 5.5 = 0.95$

Site Location – Phoenix, AZ Exposure B (residential) Risk Category I Flat ground

**ARIZONA**

2018 International Building Code with amendments (at the time of this writing) For IBC 2018 & 2021 use ASCE 7-16

<https://ascehazardtool.org/>

The screenshot displays the ASCE HAZARD TOOL interface. At the top, a blue banner reads "ASCE HAZARD TOOL". Below this, the interface is divided into several sections:

- 1 Enter Structure Information:** Includes an "Enter Location" field with a "Snap to Address" checkbox. Below this are three tabs: "ADDRESS", "LAT/LONG", and "FIND ON MAP". The "ADDRESS" tab is active, showing "Phoenix, Arizona" in the input field and a "SEARCH" button.
- 2 Requested Data:** Contains several dropdown menus and checkboxes:
  - Standard Version:** Set to "ASCE/SEI 7-16", with a red notification: "NEW! ASCE/SEI 41 now available".
  - Risk Category:** Set to "I".
  - Site Soil Class:** A dropdown menu labeled "Select Soil Class".
  - Measurements:** Radio buttons for "Customary" (selected) and "SI".
  - Load Types:** A "Select all" link and checkboxes for:
    - Wind (checked)
    - Ice (checked)
    - Rain (unchecked)
    - Tsunami (unchecked)
    - Seismic (unchecked)
    - Snow (unchecked)
    - Flood (unchecked)
    - Tornado (unchecked)
- VIEW RESULTS:** A large blue button at the bottom left.

The right side of the interface features a map of Phoenix, Arizona, with a blue location pin in the city center. The map shows major roads like Papago Fwy and AZ-101 Loop N, and geographical features like the Salt River and various canals.

Standard: ASCE/SEI 7-16

Risk Category: I

Soil Class:

Wind

95 Vmph

Ice

0 in.

q <sub>w</sub> Values	
V <sub>w</sub> (mph)	q <sub>w</sub> (psf)
85	8.02
90	8.99
95	10.02
100	11.10
105	12.24
110	13.43
115	14.68
120	15.98
125	17.34
130	18.75
135	20.23
140	21.75

K <sub>z</sub> Values for ASCE 7-10 & 7-16			
Fence Height, h (ft)	Exposure Class		
	B	C	D
0-15	0.57	0.85	1.03
16	0.59	0.86	1.04
17	0.60	0.87	1.05
18	0.61	0.88	1.06
19	0.61	0.89	1.07
20	0.62	0.90	1.08

Inverted Fence Opening Reduction Factor, R<sub>1</sub>

K <sub>e</sub> Values		
Site Elevation z <sub>e</sub> (ft)	ASCE	
	7-16 & 7-22	7-10
	K <sub>e</sub>	K <sub>e</sub> = 1.0
0	1.00	1.00
500	0.98	1.00
1,000	0.96	1.00
1,500	0.95	1.00
2,000	0.93	1.00
2,500	0.91	1.00
3,000	0.90	1.00
3,500	0.88	1.00
4,000	0.87	1.00
4,500	0.85	1.00
5,000	0.84	1.00

ε or ε'	R <sub>1</sub>	ε or ε'	R <sub>1</sub>
0.71	1.19	0.86	1.06
0.72	1.17	0.87	1.05
0.73	1.16	0.88	1.04
0.74	1.15	0.89	1.04
0.75	1.14	0.90	1.03
0.76	1.13	0.91	1.03
0.77	1.12	0.92	1.02
0.78	1.12	0.93	1.02
0.79	1.11	0.94	1.01
0.80	1.10	0.95	1.01
0.81	1.09	0.96	1.01
0.82	1.08	0.97	1.01
0.83	1.08	0.98	1.00
0.84	1.07	0.99	1.00
0.85	1.06	1.00	1.00

$$R_{1w} = 1 / (1 - (1 - \epsilon)^{1.5})$$

$$R_{1i} = 1 / (1 - (1 - \epsilon')^{1.5})$$

K<sub>zt</sub> = 1.0 for flat ground

See ASEC 7 Fig. 26.8-1 to calculate K<sub>zt</sub> values for site locations on hills or escarpments

h = 6' g = 0' s = 6' ε = 0.95 (5.25 / 5.5 = 0.95)

C<sub>fw</sub> = value determined on following pages

D<sub>w</sub> = 1.5 psf

R<sub>1w</sub> = 1.01

Case C Reduction Factor  $R_{2w} = 0.8$

Return Corner Reduction Factor,  $F_{3w} = 1.0$  as there is no return corner

$F_{hw} = 1.1$

Case C Reduction Factor, $R_2$	
s/h	$R_2$
1.000	0.80
0.975	0.83
0.950	0.85
0.925	0.88
0.900	0.90
0.875	0.93
0.850	0.95
0.825	0.98
$\geq 0.800$	1.00
$R_2 = (1.8 - s/h) \leq 1.0$	

Force Height Adjustment Factor, $F_h$		
s/h	$F_h$	Notes
1.00	1.10	For solid / mostly solid fencing ( $\epsilon$ or $\epsilon' > 0.7$ ) per Solid Wall Table, Note 3
	1.00	For open fencing ( $\epsilon$ or $\epsilon' \leq 0.7$ )
0.99	1.01	For all fence types $F_h = 2 - s/h$
0.98	1.02	
0.97	1.03	
0.96	1.04	
0.95	1.05	
0.94	1.06	
0.93	1.07	
0.92	1.08	
0.91	1.09	
0.90	1.10	

Fence Length,  $B = 96$  ft

Fencing Height,  $s = 6'$


Aspect Ratio  $B/s = 16$

Case C controls worst case post

C <sub>f</sub> values - Solid / Mostly Solid Fencing - Case C - Posts near ends and corners											
Wind Region	Aspect Ratio, B/s										
	13	16	19	22	25	28	31	34	37	40	$\geq 45$
0 to s	4.00*	4.03*	4.06*	4.09*	4.12*	4.15*	4.18*	4.21*	4.24*	4.27*	4.30*
s to 2s	2.60	2.60	2.59	2.59	2.58	2.58	2.57	2.57	2.56	2.56	2.55
2s to 3s	2.00	2.00	1.99	1.99	1.98	1.98	1.97	1.97	1.96	1.96	1.95
3s to 4s	1.50	1.54	1.57	1.61	1.64	1.68	1.71	1.75	1.78	1.82	1.85
4s to 5s	1.35	1.40	1.45	1.50	1.55	1.60	1.65	1.70	1.75	1.80	1.85
5s to 10s	0.90	0.92	0.94	0.96	0.98	1.00	1.02	1.04	1.06	1.08	1.10
>10s	0.55	0.55	0.55	0.55	0.55	0.55	0.55	0.55	0.55	0.55	0.55

For solid / mostly solid fencing, the post with the highest wind loading is typically the 1<sup>st</sup> post in from the end of the longest fence run. Return corners reduce the forces so for complicated fencing, multiple checks may need to be done to find the worst case post. In this case, a straight fence with no corners, the posts next to the end posts have the highest loading. End posts get higher wind pressures, but only half the wind area.

$L = 8'$        $R_2 = 0.8$       Worst case post  
 $B = 96'$        $R_3 = 1.0$       weighted average method  
 $s = 6'$   
 $B/s = 16$   
 $C_f = 1.07(6 \times 3.22 + 6 \times 2.08 + 4 \times 1.60) / (2 \times 8) = 2.55$

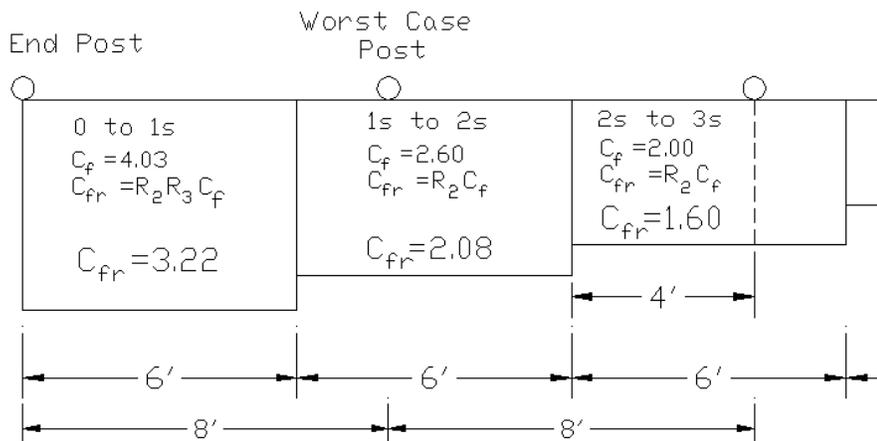

$C_{fw}$  for the worst case post = 2.55

## Worksheet – Mostly Solid / Solid Fencing – Wind Loading Only

**Site Location:** Phoenix, AZ

**Customer:**

### Site and Geometrical Variables

IBC 2018      ASCE 7- 16      Risk Category I      Frost Depth 1.0 ft

Basic Wind Speed,  $V_w =$  95 mph

Wind Pressure,  $q_w =$  10.02 psf

Exposure Category B      Topographical Factor,  $K_{zt} =$  1.0

Site Elevation,  $Z_e =$  1,086 ft      Elevation Factor,  $K_e =$  0.96

Height of fence,  $h =$  6 ft      Gap at bottom of fence,  $g =$  0 ft (zero if no gap)

Height of fencing material,  $s = h - g =$  6 ft

Velocity Pressure Exposure Coefficient,  $K_z =$  0.57

## Wind & Axial Loading

Fence Run # 1      Length of Fence, B = 96 ft      Post spacing, L = 8 ft

Post Type: Line Posts ( )      Post near end or corner (X)

Solidity Ratio,  $\epsilon =$  0.95      Inverted Fence Opening Reduction Factor,  $R_{1w} =$  1.01

Case C Reduction Factor,  $R_{2w} =$  0.8      Return Corner Reduction Factor,  $R_{3w} =$  1.0

Force Height Adjustment Factor,  $F_{hw} =$  1.1      Wind Force Coefficient,  $C_{fw} =$  2.55

$$\text{Wind area tributary to the post, } A_w = \epsilon s L = \frac{0.95}{\epsilon} \times \frac{6 \text{ ft}}{s} \times \frac{8 \text{ ft}}{L} = \frac{45.6}{A_w} \text{ ft}^2$$

Dead Load of fencing materials,  $D_m =$  2.2 psf      *weight of pickets and assuming two 2 x 4 rails*

### Lateral and Axial Forces for Wind Loading

Wind Force to the post,  $f_w = q_w K_z K_{zt} K_e R_{1w} F_{hw} C_{fw} A_w$

$$f_{min} = 0.6 (16) A_w = 9.6 \times 45.6 = 438 \text{ lbs}$$

$$f_w = \frac{10.02}{q_w} \times \frac{0.57}{K_z} \times \frac{1.0}{K_{zt}} \times \frac{0.96}{K_e} \times \frac{1.01}{R_{1w}} \times \frac{1.1}{F_{hw}} \times \frac{2.55}{C_{fw}} \times \frac{45.6}{A_w} = \frac{708}{f_w} \text{ lbs}$$

$$f_w' = 708 \text{ lbs}$$

The Axial Force supported by the post,  $p_w = D_w s L$

$$p_w = \frac{2.2 \text{ psf}}{D_m} \times \frac{6 \text{ ft}}{s} \times \frac{8 \text{ ft}}{L} = \frac{106}{p_w} \text{ lbs}$$

$$5 \times p_w = \frac{530}{\text{lbs}} \text{ (used for stability check)}$$

$f_w = 708 \text{ lbs}$      $p_w = 106 \text{ lbs}$      $5 \times p_i = 530 \text{ lbs}$

Lightest wood post that looks possible is 6 x 6 – checking #2 southern pine pressure treated

Maximum Allowable Wind Force at Mid-height, $F_w$ (lbs) & Maximum Axial Force, $P_a$ (lbs)											
Post Size	Weight $D_p$ (plf)	Fence Height, h (ft)									
		3	4	5	6	7	8	9	10	11	
#2 Southern Pine - Pressure Treated											
4 x 4	6.2	$F_w$	699	524	419	349	299	-	-	-	-
		$P_a$	7,640	4,948	3,332	2,369	1,763	-	-	-	-
6 x 4	9.8	$F_w$	1,439	1,053	823	670	561	479	416	366	325
		$P_a$	16,797	14,108	10,978	8,349	6,425	5,050	4,057	3,322	2,767
6 x 6	15.3	$F_w$	2,465	1,849	1,479	1,232	1,056	924	822	739	672
		$P_a$	26,395	22,169	17,251	13,120	10,096	7,936	6,375	5,221	4,348
#2 Western Red Cedar											
4 x 4	2.0	$F_w$	445	333	267	222	191	-	-	-	-
		$P_a$	4,959	3,419	2,356	1,692	1,266	-	-	-	-
6 x 4	3.5	$F_w$	1,010	740	579	472	395	338	294	258	230
		$P_a$	10,111	8,915	7,320	5,764	4,517	3,587	2,898	2,382	1,989
6 x 6	4.8	$F_w$	1,725	1,294	1,035	863	739	647	575	518	471
		$P_a$	15,889	14,009	11,503	9,057	7,099	5,636	4,554	3,743	3,126
Post Size	$D_p$ (plf)	Fence Height, h (ft)									
	Weight	3	4	5	6	7	8	9	10	11	

For steel pipes

Allowable Wind Force at Mid-height, $F_w$ (lbs) & Allowable Axial Force, $P_a$ (lbs) - Group IA and IC Posts																				
Post Size	Weight, $D_p$ lbs / ft	Fence Height, H (ft)																		
		5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
Schedule 40 / ASTM F1043 / Group IA / 30 ksi																				
1-5/8"	2.3	$F_w$	182	152	130	114	-	-	-	-	-	-	-	-	-	-	-	-	-	-
		$P_a$	1,745*	1,212*	890*	681*	-	-	-	-	-	-	-	-	-	-	-	-	-	-
1-7/8"	2.7	$F_w$	252	210	180	157	140	-	-	-	-	-	-	-	-	-	-	-	-	-
		$P_a$	2,773*	1,926*	1,415*	1,083*	856*	-	-	-	-	-	-	-	-	-	-	-	-	-
2-3/8"	3.7	$F_w$	427	356	305	267	237	213	194	178	-	-	-	-	-	-	-	-	-	-
		$P_a$	5,943	4,127	3,032*	2,321*	1,834*	1,485*	1,227*	1,031*	-	-	-	-	-	-	-	-	-	-
2-7/8"	5.8	$F_w$	817	680	583	510	453	408	371	340	314	291	272	-	-	-	-	-	-	-
		$P_a$	13,272	9,494	6,975	5,340*	4,219*	3,418*	2,824*	2,373*	2,022*	1,743*	1,519*	-	-	-	-	-	-	-
3-1/2"	7.6	$F_w$	1,310	1,092	936	819	728	655	595	546	504	468	436	409	385	364	-	-	-	-
		$P_a$	22,458	17,944	13,733	10,514	8,307	6,729*	5,561*	4,673*	3,981*	3,433*	2,990*	2,628*	2,328*	2,076*	-	-	-	-
4"	9.1	$F_w$	1,809	1,507	1,292	1,130	1,005	904	822	753	695	646	603	565	532	502	476	452	-	-
		$P_a$	30,535	25,757	21,064	16,666	13,168	10,666	8,815*	7,407*	6,311*	5,442*	4,740*	4,166*	3,690*	3,292*	2,954*	2,666*	-	-
4-1/2"	10.8	$F_w$	2,419	2,016	1,728	1,512	1,344	1,209	1,099	1,008	930	864	806	756	711	672	636	604	-	-
		$P_a$	39,301	34,390	29,370	24,481	19,876	16,100	13,305	11,180	9,526*	8,214*	7,155*	6,289*	5,570*	4,969*	4,459*	4,025*	-	-
5-9/16"	14.6	$F_w$	4,069	3,391	2,906	2,543	2,260	2,034	1,849	1,695	1,565	1,453	1,356	1,271	1,196	1,130	1,070	1,017	-	-
		$P_a$	59,190	54,288	49,016	43,565	38,117	32,830	27,809	23,367	19,910	17,167	14,955*	13,144*	11,643*	10,385*	9,321*	8,412*	-	-
6-5/8"	19.0	$F_w$	6,319	5,266	4,514	3,949	3,511	3,159	2,872	2,633	2,430	2,257	2,106	1,974	1,858	1,755	1,663	1,579	-	-
		$P_a$	81,532	76,751	71,462	65,810	59,943	54,002	48,119	42,408	36,967	31,890	27,780	24,416	21,628	19,291*	17,314*	15,626*	-	-
8-5/8"	28.6	$F_w$	12,434	10,362	8,881	7,771	6,908	6,217	5,652	5,181	4,782	4,440	4,144	3,885	3,657	3,454	3,272	3,108	-	-
		$P_a$	129,849	125,342	120,217	114,564	108,477	102,056	95,401	88,609	81,773	74,982	68,314	61,841	55,623	49,640	44,552	40,208	-	-
40 Weight / ASTM F1043 / Group IC / 50 ksi																				
1-5/8"	1.8	$F_w$	244	203	174	152	-	-	-	-	-	-	-	-	-	-	-	-	-	-
		$P_a$	1,455*	1,010*	742*	568*	-	-	-	-	-	-	-	-	-	-	-	-	-	-
1-7/8"	2.3	$F_w$	350	292	250	219	194	175	-	-	-	-	-	-	-	-	-	-	-	-
		$P_a$	2,385	1,656*	1,217*	931*	736*	596*	-	-	-	-	-	-	-	-	-	-	-	-
2-3/8"	3.1	$F_w$	608	507	434	380	338	304	276	253	-	-	-	-	-	-	-	-	-	-
		$P_a$	5,178	3,596	2,642*	2,022*	1,598*	1,294*	1,069*	899*	-	-	-	-	-	-	-	-	-	-
2-7/8"	4.6	$F_w$	1,095	912	782	684	608	547	497	456	421	391	365	-	-	-	-	-	-	-
		$P_a$	11,274	7,829	5,752	4,404*	3,479*	2,818*	2,329*	1,957*	1,667*	1,438*	1,252*	-	-	-	-	-	-	-
4"	6.6	$F_w$	2,222	1,852	1,587	1,389	1,234	1,111	1,010	926	854	793	740	694	653	617	584	555	-	-
		$P_a$	28,899	22,018	16,247	12,439	9,828	7,961	6,579*	5,528*	4,710*	4,061*	3,538*	3,109*	2,754*	2,457*	2,205*	1,990*	-	-
4-1/2"	7.4	$F_w$	2,851	2,376	2,036	1,782	1,584	1,425	1,296	1,188	1,096	1,018	950	891	838	792	750	712	-	-
		$P_a$	37,346	30,183	23,447	17,951	14,184	11,489	9,495	7,978	6,798*	5,861*	5,106*	4,487*	3,975*	3,546*	3,182*	2,872*	-	-

## Post Selection

Using the diameter of the desired post size, O.D., and the Fence Height, h, look through the post charts for post types that have  $F_a$  values larger than the  $f_w'$  value, and  $P_a$  values larger than the  $p_w$  value. If the post has an \* next to the  $P_a$  value, only use it if the  $P_a$  value is  $\geq 5 \times p_w$  due to stability requirements.

Put in the O.D, post type, weight per foot,  $D_p$  and fence height, h and calculate  $p_w'$  to include the weight of the post. Add any additional weight if needed.

$f_w' / F_a$  is the bending strength ratio for Wind.

$p_w' / P_a$  is the axial strength ratio for Wind

If the sum of the bending strength and axial strength ratios for both Wind and Wind & Ice loading are  $\leq 1.0$ , the post is acceptable.

O.D.	Post Type	D <sub>p</sub> (lb/f)	h (ft)	p <sub>w</sub> ' = p <sub>w</sub> + (D <sub>p</sub> × h)	
6 x 6	#2 pine PT	15.3	6	p <sub>w</sub> ' = 198 lbs	
<b>Wind</b>					
$\frac{f_w'}{F_a} = \frac{708}{1,232} = 0.57$		$\frac{p_w'}{P_a} = \frac{198}{13,120} = 0.2$		$\frac{f_w'}{F_a} + \frac{p_w'}{P_a} = 0.59$	

O.D.	Post Type	D <sub>p</sub> (lb/f)	h (ft)	p <sub>w</sub> ' = p <sub>w</sub> + (D <sub>p</sub> × h)	
3-1/2"	Sched 40 / 30 ksi	7.6	6	p <sub>w</sub> ' = 152 lbs	
<b>Wind</b>					
$\frac{f_w'}{F_a} = \frac{708}{1,092} = 0.65$		$\frac{p_w'}{P_a} = \frac{152}{17,944} = 0.01$		$\frac{f_w'}{F_a} + \frac{p_w'}{P_a} = 0.66$	

O.D.	Post Type	D <sub>p</sub> (lb/f)	h (ft)	p <sub>w</sub> ' = p <sub>w</sub> + (D <sub>p</sub> × h)	
2-7/8"	40 wt / 50 ksi	4.6	6	p <sub>w</sub> ' = 134 lbs	
<b>Wind</b>					
$\frac{f_w'}{F_a} = \frac{708}{912} = 0.78$		$\frac{p_w'}{P_a} = \frac{134}{7,829} = 0.02$		$\frac{f_w'}{F_a} + \frac{p_w'}{P_a} = 0.80$	

Next, size post footing assuming 2-7/8" dia post - 6-7/8" minium footing diameter - start with 9" (common auger)

With a 9" dia footing, the depth had to be over 6'. Trying again with a 12" diameter footing.

### Footing Sizing (non-constrained footings)

Design Footing Depth,  $D = \underline{5.5}$  ft      Footing Diameter,  $b = \underline{1.0}$  ft

Assumes soil class 4

Lateral Bearing Pressure per foot of depth,  $S = \underline{150}$  psf / ft    per geotechnical analysis or table 1806.2

Maximum Wind Force,  $P = f_w' = \underline{708}$  lbs      Post Height,  $h = \underline{6}$  ft

Modifier for Isolated Posts,  $M = 2.0$       per IBC §1086.3.4

Allowable Lateral Soil Bearing Pressure for non-constrained footings,  $S_1 = \frac{1}{3} D S M$

$$S_1 = \frac{1}{3} \times \frac{5.5}{D} \times \frac{150}{S} \times \frac{2.0}{M} = \frac{550}{S_1} \text{ psf} \quad \text{per IBC §1807.3.2.1}$$

Soil Bearing Factor,  $A = 2.34 P / (S_1 b)$       per IBC §1807.3.2.1

$$A = 2.34 \times \frac{708}{P} \div \left( \frac{550}{S_1} \times \frac{1.0}{b} \right) = \frac{3.012}{A}$$

Minimum Depth,  $d = \frac{1}{2} A \left( 1 + \sqrt{1 + \frac{4.36 \frac{1}{2} h}{A}} \right)$       per Eq. 18-1, **modified for fencing**

$$d = \frac{1}{2} \times \frac{3.012}{A} \times \left( 1 + \sqrt{1 + \left( 4.36 \times \frac{1}{2} \times \frac{5.5}{h} \div \frac{3.012}{A} \right)} \right) = \frac{5.0}{d} \text{ ft} \quad D > d - \text{OK}$$

If you run the numbers again, you can get down to 5' 3" depth in this case

Area of the bottom of the footing,  $A_f = \pi \left( \frac{1}{2} b \right)^2 = 3.14 \times \left( \frac{1}{2} \times \frac{1.0}{b} \right)^2 = \frac{0.785}{A_f} \text{ ft}^2$

Footing Volume,  $V = A_f D = \frac{0.785}{A_f} \times \frac{5.5}{D} = \frac{4.32}{V} \text{ ft}^3$

Weight of footing,  $D_f = 150 V = 150 \times \frac{4.32}{V} = \frac{648}{D_f}$  lbs      (Typical Concrete weight is 150 lbs / ft<sup>3</sup>)

Axial Dead Load,  $D_{\max} = D_f + p_w'$

$$D_{\max} = \frac{648}{D_f} + \frac{134}{p_w'} = \frac{782}{D_{\max}} \text{ lbs}$$

assumes soil class 4

Maximum Vertical Foundation Pressure,  $S_y = \underline{2,000}$  psf      per geotechnical analysis or table 1806.2

$$\text{Maximum Axial Pressure on the soil, } s_y = \frac{D_{\max}}{A_f} = \frac{728}{D_{\max}} \div \frac{0.785}{A_f} = \frac{996}{S_y} \text{ psf}$$

Actual to Allowable Soil Strength Ratio,  $s_y / S_y = \frac{996}{S_y} \div \frac{2,000}{S_y} = \underline{0.50} \leq 1.0$  is OK

$s_y / S_y$  must be less than 1.0. If not, start over with a larger footing diameter,  $b$